

(PED14092) May 7<sup>th</sup>, 2014


# **Piers 5-8 Sewage Pumping Station and Facilities, Schedule B Class Environmental Assessment**



Hamilton

(PED14092) May 7<sup>th</sup>, 2014

# Piers 5-8 Pumping Station EA Study Area

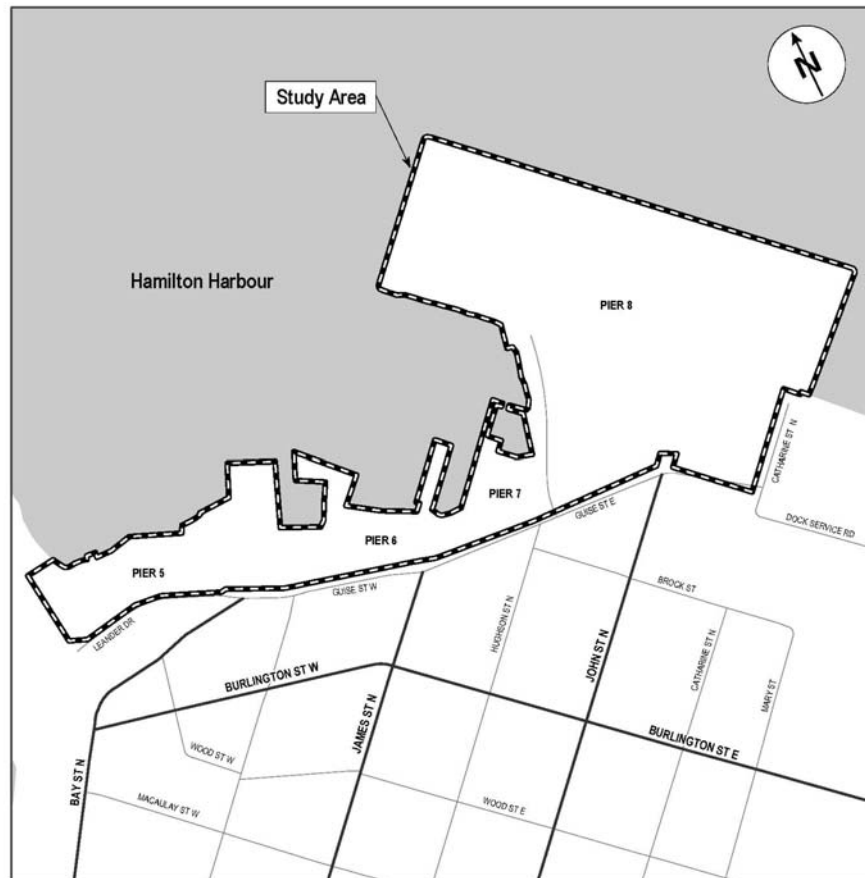

Hamilton

(PED14092) May 7<sup>th</sup>, 2014

# Municipal Class EA process

Phase 1 - identification of problem or opportunity

Phase 2 - identification of solutions to the problem

Phase 3 - identification of alternative designs for the preferred solution

Phase 4 - completion of the Environmental Study Report

Phase 5 – Implementation of preferred design



Hamilton

# **Piers 5-8 Pumping Station(s) and Facilities Process**

- Pumping Stations are Schedule B project
- must complete Phases 1 and 2 of the EA process



## Problem/Opportunity Statement

The Pier 8 pumping station has operational deficiencies which include:

- No standby power generator to provide a backup power source in the event of power failure; and,
- Inadequate capacity to manage existing development sewage flows and / or service future development.



# Technical Studies

- West Harbour Servicing Studies
- Natural Environment Existing Conditions Report
- Archaeological and Built Heritage Impact Assessment



# Consultation


- Technical Advisory and Agency Meetings(2)
- Public Information Centre (2)



Hamilton



# Preferred Alternative

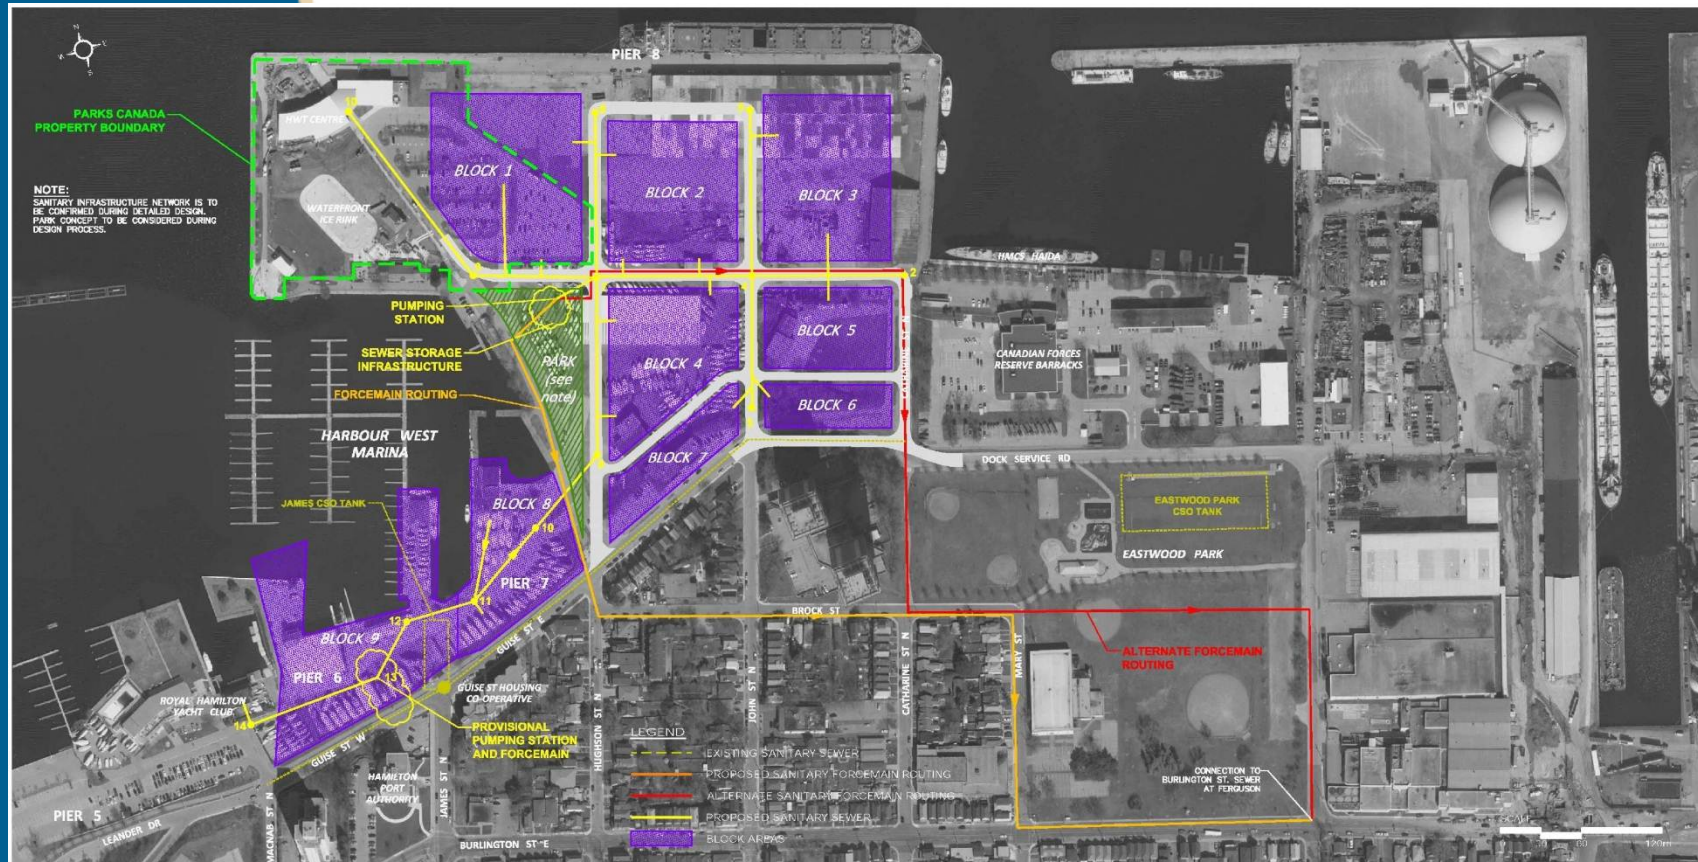

- New pumping stations (or facilities) and forcemains



# Staff Recommendation (PED14092)

- a) That the Acting General Manager of Planning and Economic Development, be authorized and directed to file the Notice of Completion, and issue the Project File Report for the Class Environmental Assessment for Piers 5-8 Sewage Pumping Station Facilities for the mandatory 30 day public review period;
- b) That upon completion of the 30 day public review period, the Acting General Manager of Planning and Economic Development be authorized and directed to proceed with detailed design and implementation of the preferred solution of the Class Environmental Assessment for Piers 5-8 Sewage Pumping Station Facilities, provided that no Part II Orders to the Minister of the Environment are received.



Hamilton

(PED14092) May 7<sup>th</sup>, 2014