

CITY OF HAMILTON
CARLISLE DRINKING WATER SYSTEM (DWS)
WATER QUALITY ANNUAL REPORT

2018

Ontario Regulation 170/03 Section 11

TABLE OF CONTENTS

General Information	3
Carlisle DWS	5
Carlisle DWS Map	6
Water Treatment Chemicals Breakdown of Monetary Expenses List of AWQI Notices	7
Microbiological Testing Operational Testing Additional Testing	8
Summary of Inorganic Parameters	9
Summary of Lead Testing	11
Summary of Organic Parameters	12
Parameters Exceeding Prescribed Half-Standard (Schedule 2 of Ontario DWQS)	18



Drinking Water System Number	Drinking Water System Name	Drinking Water System Owner	Drinking Water System Category	Period Being Reported
220004108	Carlisle Drinking Water System FDC01, FDC02, FDC03(R), FDC05	City of Hamilton	Large Municipal Residential	January 1, 2018 to December 31, 2018

Complete if your Category is "Large Municipal Residential" or "Small Municipal Residential"

Does your Drinking Water System serve more than 10,000 people? YES ☒ NO

Is your annual report available to the public at no charge on a website on the Internet? www.hamilton.ca/waterquality ☒ YES NO

Location where Summary Report required under Ontario Regulation 170/03 Schedule 22 will be available for inspection: 700 Woodward Administration Building, Compliance Support Group

Complete for all other Categories

Number of Designated Facilities served: N/A

Did you provide a copy of your annual report to all Designated Facilities you serve? N/A

Number of Interested Authorities you report to: N/A

Did you provide a copy of your annual report to all Interested Authorities you report to for each Designated Facility? N/A





List all Drinking Water Systems (if any), which receive all of their drinking water from your system:

Drinking Water System Name	Drinking Water System Number
None other than Carlisle System	220004108



Did you provide a copy of your annual report to all Drinking Water System owners that are connected to you and to whom you provide all of its drinking water?

YES NO NOT APPLICABLE



Indicate how you notified system users that your annual report is available, and is free of charge:

System users are notified through the local newspaper that the annual report is available online free of charge at www.hamilton.ca/waterquality.



The Carlisle water supply system consists of four wells, one elevated water storage tank, treatment, sampling and analysis, which services a population of approximately 1,800 people. The water source for the community of Carlisle is ground water.

Water Wells:

- Carlisle Well FDC01 has a diameter of 157mm and a depth of approximately 40 metres.
- Carlisle Well FDC02 has a diameter of 300mm at a depth of 2.6 metres and a diameter of 250mm from 2.6 metres to 36 metres.
- Carlisle Well FDC03R has a diameter of 200mm and a depth of approximately 33.5 metres. It is a drilled ground water well under the influence of surface water (GUDI).
- Carlisle Well FDC05 has a diameter of 214mm and a depth of approximately 28 metres. It is a drilled ground water well under the influence of surface water (GUDI).

Treatment:


- Within a treatment well house, both wells, FDC01 and FDC02 are joined to a common header for flow metering and disinfection. Sodium hypochlorite (chlorine) within a chlorine contact chamber is used to ensure disinfection of the water.
- Within the well house, both FDC03R and FDC05 discharges have separate flow metering, filtration and UV light disinfection streams. The flows are combined for treatment by sodium hypochlorite (chlorine) within a chlorine contact chamber to ensure disinfection of the water prior to entering the distribution system.
- Fluoridation is not carried out at any of the Carlisle community wells.

Water Storage:

An elevated water storage tank is located at the same site as wells FDC01 and FDC02. The storage tank has an operating capacity of 1,400m³. It was designed for peak hour water demand equalization as well as fire and emergency storage.

Sampling & Analysis:

All wells are equipped with on-line chlorine residual and turbidity analyzers that continually monitor the treated water quality. Raw, treated and distribution water is sampled and analyzed weekly. In addition, chlorine residual in the distribution system is analyzed daily.

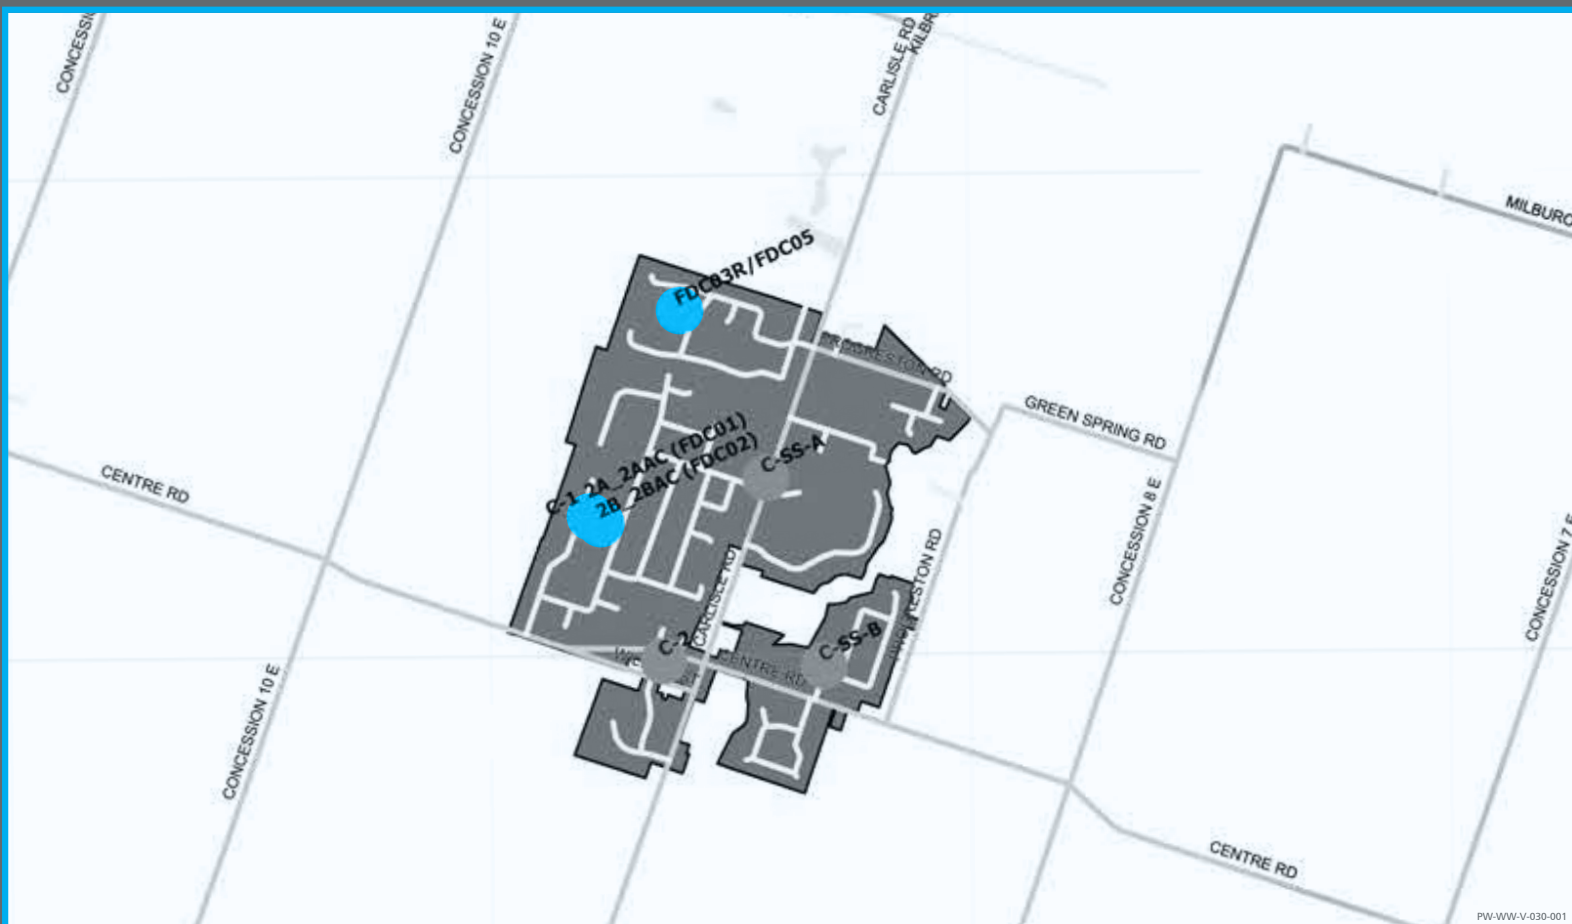


PW-WW-V-030-001

CARLISLE DRINKING WATER SYSTEM



List all water treatment chemicals used over this reporting period:

→ Sodium Hypochlorite

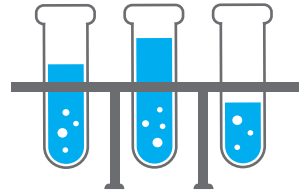

Were any significant expenses incurred to:

Install required equipment	YES	☐ NO
Repair required equipment	☐ YES	NO
Replace required equipment	YES	☐ NO

2018 CARLISLE DRINKING WATER SYSTEM HIGHLIGHTS

UV System Maintenance \$42,000

Carlisle Conservation Committee (C3) continued water conservation efforts through 2018.
www.hamilton.ca/C3

Provide details on the notices submitted in accordance with subsection 18(1) of the Safe Drinking Water Act or section 16-4 of Schedule 16 of O.Reg.170/03 and reported to Spills Action Centre.

Notification Date (m-d-y)	Location of Adverse	Adverse Water Quality Incident	Resolution
---------------------------	---------------------	--------------------------------	------------

We are pleased to announce that there were no Adverse Water Quality Incidents for the period of January to December 2018.



Microbiological testing done under Schedule 10, 11, 12 and 17, 18 of Regulation 170/03, during this reporting period.

SAMPLE TYPE	NUMBER OF SAMPLES	RANGE OF E.COLI RESULTS (MIN #) to (MAX #) CFU/100ML	RANGE OF TOTAL COLIFORM RESULTS (MIN #) to (MAX #) CFU/100ML	NUMBER OF HPC SAMPLES	RANGE OF HPC RESULTS (MIN #) to (MAX #) CFU/1ML
RAW - FDC01	52	0	0	NA	NA
RAW - FDC02	52	0	0	NA	NA
RAW - FDC03(R)	53	0	0	NA	NA
RAW - FDC05	53	0	0	NA	NA
TREATED - FDC01	52	0	0	52	0 to 1
TREATED - FDC02	52	0	0	52	0 to 1
TREATED - FDC03(R)	53	0	0	53	0 to 12
TREATED - FDC05	53	0	0	53	0 to 1
DISTRIBUTION	208	0	0	208	0 to 5

Operational testing done under Schedule 7, 8 or 9 of Regulation 170/03 during the period covered by this Annual Report.

NOTE: For continuous monitors use 8760 as the number of samples.

PARAMETER - SAMPLE TYPE	NUMBER OF GRAB SAMPLES	RANGE OF RESULTS (MIN #) to (MAX #)	UNIT OF MEASURE
TURBIDITY - RAW - FDC01	52	0.05 to 0.33	NTU
TURBIDITY - RAW - FDC02	52	0.03 to 0.28	NTU
TURBIDITY - RAW - FDC03(R)	8,760	0.05 to 0.70	NTU
TURBIDITY - RAW - FDC05	8,760	0.03 to 0.94	NTU
FREE CHLORINE - TREATED - FDC01 AND FDC02	8,760	1.34 to 2.89	mg/L
FREE CHLORINE - TREATED - FDC03(R) AND FDC05	8,760	1.22 to 2.57	mg/L
FREE CHLORINE - DISTRIBUTION	365	1.03 to 2.27	mg/L

Summary of additional testing and sampling carried out in accordance with the requirement of a licence, approval, order or other legal instrument.

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE
N/A	-	-	-

Summary of Inorganic parameters required by Regulation 170/03 and tested during this reporting period.

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
CARLISLE WELL FDC01 - TREATED				
ANTIMONY	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
ARSENIC	2018-05-15 to 2018-10-16	0.0001 to 0.0002	mg/L	0
BARIUM	2018-05-15 to 2018-10-16	0.0892 to 0.0906	mg/L	0
BORON	2018-05-15 to 2018-10-16	0.013 to 0.022	mg/L	0
CADMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
CHROMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
FLUORIDE	2018-05-15 to 2018-10-16	0.07	mg/L	0
MERCURY	2018-05-15 to 2018-10-16	<0.00005	mg/L	0
NITRATE AS N	2018-01-22 to 2018-10-16	1.55 to 2.66	mg/L	0
NITRITE AS N	2018-01-22 to 2018-10-16	<0.01	mg/L	0
SELENIUM	2018-05-15 to 2018-10-16	0.0002	mg/L	0
SODIUM	2018-05-15 to 2018-10-16	17.9 to 19.9	mg/L	0
URANIUM	2018-05-15 to 2018-10-16	0.414 to 0.428	ug/L	0

CARLISLE WELL FDC02 - TREATED				
ANTIMONY	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
ARSENIC	2018-05-15 to 2018-10-16	0.0001	mg/L	0
BARIUM	2018-05-15 to 2018-10-16	0.0925 to 0.0928	mg/L	0
BORON	2018-05-15 to 2018-10-16	0.014 to 0.017	mg/L	0
CADMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
CHROMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
FLUORIDE	2018-05-15 to 2018-10-16	0.06 to 0.07	mg/L	0
MERCURY	2018-05-15 to 2018-10-16	<0.00005	mg/L	0
NITRATE AS N	2018-01-22 to 2018-10-16	2.08 to 3.24	mg/L	0
NITRITE AS N	2018-01-22 to 2018-10-16	<0.01	mg/L	0
SELENIUM	2018-05-15 to 2018-10-16	0.0002	mg/L	0
SODIUM	2018-05-15 to 2018-10-16	28.1 to 29.7	mg/L	0
URANIUM	2018-05-15 to 2018-10-16	0.365 to 0.422	ug/L	0

...continued on next page

Summary of Inorganic parameters required by Regulation 170/03 and tested during this reporting period. (continued)...

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
CARLISLE WELL FDC03(R) - TREATED				
ANTIMONY	2018-05-15 to 2018-10-16	0.0002	mg/L	0
ARSENIC	2018-05-15 to 2018-10-16	0.0004	mg/L	0
BARIUM	2018-05-15 to 2018-10-16	0.0750 to 0.0794	mg/L	0
BORON	2018-05-15 to 2018-10-16	0.020 to 0.023	mg/L	0
CADMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
CHROMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
FLUORIDE	2018-05-15 to 2018-10-16	0.07	mg/L	0
MERCURY	2018-05-15 to 2018-10-16	<0.00005	mg/L	0
NITRATE AS N	2018-01-22 to 2018-10-16	0.18 to 0.34	mg/L	0
NITRITE AS N	2018-01-22 to 2018-10-16	<0.01	mg/L	0
SELENIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
SODIUM	2018-05-15 to 2018-10-16	46.1 to 48.8	mg/L	0
URANIUM	2018-05-15 to 2018-10-16	0.698 to 0.709	ug/L	0
CARLISLE WELL FDC05 - TREATED				
ANTIMONY	2018-05-15 to 2018-10-16	<0.0001 to 0.0001	mg/L	0
ARSENIC	2018-05-15 to 2018-10-16	0.0009 to 0.0014	mg/L	0
BARIUM	2018-05-15 to 2018-10-16	0.0784 to 0.0809	mg/L	0
BORON	2018-05-15 to 2018-10-16	0.020 to 0.023	mg/L	0
CADMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
CHROMIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
FLUORIDE	2018-05-15 to 2018-10-16	0.07 to 0.08	mg/L	0
MERCURY	2018-05-15 to 2018-10-16	<0.00005	mg/L	0
NITRATE AS N	2018-01-22 to 2018-10-16	<0.01 to 0.24	mg/L	0
NITRITE AS N	2018-01-22 to 2018-10-16	<0.01	mg/L	0
SELENIUM	2018-05-15 to 2018-10-16	<0.0001	mg/L	0
SODIUM	2018-05-15 to 2018-10-16	51.2 to 55.7	mg/L	0
URANIUM	2018-05-15 to 2018-10-16	0.459 to 0.703	ug/L	0

Summary of lead testing under Schedule 15.1 during this reporting period.

LOCATION TYPE	NO. OF SAMPLES REQUIRED	NO. OF SAMPLES TAKEN	RANGE OF pH RESULTS (min #) to (max #) pH Units	RANGE OF ALKALINITY RESULTS (min #) to (max #) mg/L	RANGE OF LEAD RESULTS (min #) to (max #) mg/L	NO. OF LEAD AWQIs	NO. OF LEAD EXCEEDANCES
PLUMBING-NR	N/A	N/A	N/A	N/A	N/A	N/A	N/A
PLUMBING-R	N/A	N/A	N/A	N/A	N/A	N/A	N/A
DISTRIBUTION	4	4	7.27 to 7.31	309 to 320	N/A	N/A	N/A

NR - Non Residential R - Residential



Summary of Organic parameters required by Regulation 170/03 and tested during this reporting period.

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
CARLISLE WELL FDC01 - TREATED				
1,1-DICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROETHANE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,4-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
BENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CARBON TETRACHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CHLOROBENZENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0
DICHLOROMETHANE	2018-05-15 to 2018-10-16	<0.5	ug/L	0
ETHYLBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TETRACHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TOLUENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TRICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
VINYL CHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
XYLENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0
2,3,4,6-TETRACHLOROPHENOL	2018-05-15	<0.2	ug/L	0
2,4,6-TRICHLOROPHENOL	2018-05-15	<0.25	ug/L	0
2,4-DICHLOROPHENOXY ACETIC ACID (2,4-D)	2018-05-15	<0.19	ug/L	0
2,4-DICHLOROPHENOL	2018-05-15	<0.15	ug/L	0
ALACHLOR	2018-05-15	<0.02	ug/L	0
ATRAZINE + DESETHYL-ATRAZINE METABOLITES	2018-05-15	<0.01	ug/L	0
AZINPHOS-METHYL	2018-05-15	<0.05	ug/L	0
BENZO[A]PYRENE	2018-05-15	<0.004	ug/L	0
BROMOXYNIL	2018-05-15	<0.33	ug/L	0
CARBARYL	2018-05-15	<0.05	ug/L	0
CARBOFURAN	2018-05-15	<0.01	ug/L	0
CHLORPYRIFOS	2018-05-15	<0.02	ug/L	0
DIAZINON	2018-05-15	<0.02	ug/L	0
DICAMBA	2018-05-15	<0.20	ug/L	0
DICLOFOP-METHYL	2018-05-15	<0.40	ug/L	0
DIMETHOATE	2018-05-15	<0.03	ug/L	0

...continued on next page

Summary of Organic parameters required by Regulation 170/03 and tested during this reporting period. (continued)...

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
DIQUAT	2018-05-15	<1	ug/L	0
DIURON	2018-05-15	<0.03	ug/L	0
GLYPHOSATE	2018-05-15	<1	ug/L	0
MALATHION	2018-05-15	<0.02	ug/L	0
MCPA (2-METHYL-4-CHLOROPHENOXYACETIC ACID)	2018-05-15	<0.00012	mg/L	0
METOLACHLOR	2018-05-15	<0.01	ug/L	0
METRIBUZIN (SENCOR)	2018-05-15	<0.02	ug/L	0
PARAQUAT	2018-05-15	<1	ug/L	0
POLYCHLORINATED BIPHENYLS (PCB)	2018-05-15	<0.05	ug/L	0
PENTACHLOROPHENOL	2018-05-15	<0.15	ug/L	0
PHORATE	2018-05-15	<0.01	ug/L	0
PICLORAM	2018-05-15	<1	ug/L	0
PROMETRYNE	2018-05-15	<0.03	ug/L	0
SIMAZINE	2018-05-15	<0.01	ug/L	0
TERBUFOS	2018-05-15	<0.01	ug/L	0
TRIALATE	2018-05-15	<0.01	ug/L	0
TRIFLURALIN	2018-05-15	<0.02	ug/L	0

CARLISLE WELL FDC02 - TREATED

1,1-DICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROETHANE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,4-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
BENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CARBON TETRACHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CHLOROBENZENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0
DICHLOROMETHANE	2018-05-15 to 2018-10-16	<0.5	ug/L	0
ETHYLBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TETRACHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TOLUENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TRICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
VINYL CHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0

...continued on next page

Summary of Organic parameters required by Regulation 170/03 and tested during this reporting period. (continued)...

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
XYLENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0
2,3,4,6-TETRACHLOROPHENOL	2018-05-15	<0.2	ug/L	0
2,4,6-TRICHLOROPHENOL	2018-05-15	<0.25	ug/L	0
2,4-DICHLOROPHENOXY ACETIC ACID (2,4-D)	2018-05-15	<0.19	ug/L	0
2,4-DICHLOROPHENOL	2018-05-15	<0.15	ug/L	0
ALACHLOR	2018-05-15	<0.02	ug/L	0
ATRAZINE + DESETHYL-ATRAZINE METABOLITES	2018-05-15	<0.01	ug/L	0
AZINPHOS-METHYL	2018-05-15	<0.05	ug/L	0
BENZO[A]PYRENE	2018-05-15	<0.004	ug/L	0
BROMOXYNIL	2018-05-15	<0.33	ug/L	0
CARBARYL	2018-05-15	<0.05	ug/L	0
CARBOFURAN	2018-05-15	<0.01	ug/L	0
CHLORPYRIFOS	2018-05-15	<0.02	ug/L	0
DIAZINON	2018-05-15	<0.02	ug/L	0
DICAMBA	2018-05-15	<0.20	ug/L	0
DICLOFOP-METHYL	2018-05-15	<0.40	ug/L	0
DIMETHOATE	2018-05-15	<0.03	ug/L	0
DIQUAT	2018-05-15	<1	ug/L	0
DIURON	2018-05-15	<0.03	ug/L	0
GLYPHOSATE	2018-05-15	<1	ug/L	0
MALATHION	2018-05-15	<0.02	ug/L	0
MCPA (2-METHYL-4-CHLOROPHENOXYACETIC ACID)	2018-05-15	<0.00012	mg/L	0
METOLACHLOR	2018-05-15	<0.01	ug/L	0
METRIBUZIN (SENCOR)	2018-05-15	<0.02	ug/L	0
PARAQUAT	2018-05-15	<1	ug/L	0
POLYCHLORINATED BIPHENYLS (PCB)	2018-05-15	<0.05	ug/L	0
PENTACHLOROPHENOL	2018-05-15	<0.15	ug/L	0
PHORATE	2018-05-15	<0.01	ug/L	0
PICLORAM	2018-05-15	<1	ug/L	0
PROMETRYNE	2018-05-15	<0.03	ug/L	0

...continued on next page

Summary of Organic parameters required by Regulation 170/03 and tested during this reporting period. (continued)...

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
SIMAZINE	2018-05-15	<0.01	ug/L	0
TERBUFOS	2018-05-15	<0.01	ug/L	0
TRIALATE	2018-05-15	<0.01	ug/L	0
TRIFLURALIN	2018-05-15	<0.02	ug/L	0

CARLISLE WELL FDC03(R) - TREATED

1,1-DICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROETHANE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,4-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
BENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CARBON TETRACHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CHLOROBENZENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0
DICHLOROMETHANE	2018-05-15 to 2018-10-16	<0.5	ug/L	0
ETHYLBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TETRACHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TOLUENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TRICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
VINYL CHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
XYLENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0
2,3,4,6-TETRACHLOROPHENOL	2018-05-15	<0.2	ug/L	0
2,4,6-TRICHLOROPHENOL	2018-05-15	<0.25	ug/L	0
2,4-DICHLOROPHENOXY ACETIC ACID (2,4-D)	2018-05-15	<0.19	ug/L	0
2,4-DICHLOROPHENOL	2018-05-15	<0.15	ug/L	0
ALACHLOR	2018-05-15	<0.02	ug/L	0
ATRAZINE + DESETHYL-ATRAZINE METABOLITES	2018-05-15	<0.01	ug/L	0
AZINPHOS-METHYL	2018-05-15	<0.05	ug/L	0
BENZO[A]PYRENE	2018-05-15	<0.004	ug/L	0
BROMOXYNIL	2018-05-15	<0.33	ug/L	0
CARBARYL	2018-05-15	<0.05	ug/L	0
CARBOFURAN	2018-05-15	<0.01	ug/L	0

...continued on next page

Summary of Organic parameters required by Regulation 170/03 and tested during this reporting period. (continued)...

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
CHLORPYRIFOS	2018-05-15	<0.02	ug/L	0
DIAZINON	2018-05-15	<0.02	ug/L	0
DICAMBA	2018-05-15	<0.20	ug/L	0
DICLOFOP-METHYL	2018-05-15	<0.40	ug/L	0
DIMETHOATE	2018-05-15	<0.03	ug/L	0
DIQUAT	2018-05-15	<1	ug/L	0
DIURON	2018-05-15	<0.03	ug/L	0
GLYPHOSATE	2018-05-15	<1	ug/L	0
MALATHION	2018-05-15	<0.02	ug/L	0
MCPA (2-METHYL-4-CHLOROPHENOXYACETIC ACID)	2018-05-15	<0.00012	mg/L	0
METOLACHLOR	2018-05-15	<0.01	ug/L	0
METRIBUZIN (SENCOR)	2018-05-15	<0.02	ug/L	0
PARAQUAT	2018-05-15	<1	ug/L	0
POLYCHLORINATED BIPHENYLS (PCB)	2018-05-15	<0.05	ug/L	0
PENTACHLOROPHENOL	2018-05-15	<0.15	ug/L	0
PHORATE	2018-05-15	<0.01	ug/L	0
PICLORAM	2018-05-15	<1	ug/L	0
PROMETRYNE	2018-05-15	<0.03	ug/L	0
SIMAZINE	2018-05-15	<0.01	ug/L	0
TERBUFOS	2018-05-15	<0.01	ug/L	0
TRIALATE	2018-05-15	<0.01	ug/L	0
TRIFLURALIN	2018-05-15	<0.02	ug/L	0

CARLISLE WELL FDC05 - TREATED

1,1-DICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,2-DICHLOROETHANE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
1,4-DICHLOROBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
BENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CARBON TETRACHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
CHLOROBENZENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0

...continued on next page

Summary of Organic parameters required by Regulation 170/03 and tested during this reporting period. (continued)...

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
DICHLOROMETHANE	2018-05-15 to 2018-10-16	<0.5	ug/L	0
ETHYLBENZENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TETRACHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TOLUENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
TRICHLOROETHYLENE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
VINYL CHLORIDE	2018-05-15 to 2018-10-16	<0.2	ug/L	0
XYLENE	2018-05-15 to 2018-10-16	<0.3	ug/L	0
2,3,4,6-TETRACHLOROPHENOL	2018-05-15	<0.2	ug/L	0
2,4,6-TRICHLOROPHENOL	2018-05-15	<0.25	ug/L	0
2,4-DICHLOROPHENOXY ACETIC ACID (2,4-D)	2018-05-15	<0.19	ug/L	0
2,4-DICHLOROPHENOL	2018-05-15	<0.15	ug/L	0
ALACHLOR	2018-05-15	<0.02	ug/L	0
ATRAZINE + DESETHYL-ATRAZINE METABOLITES	2018-05-15	<0.01	ug/L	0
AZINPHOS-METHYL	2018-05-15	<0.05	ug/L	0
BENZO[A]PYRENE	2018-05-15	<0.004	ug/L	0
BROMOXYNIL	2018-05-15	<0.33	ug/L	0
CARBARYL	2018-05-15	<0.05	ug/L	0
CARBOFURAN	2018-05-15	<0.01	ug/L	0
CHLORPYRIFOS	2018-05-15	<0.02	ug/L	0
DIAZINON	2018-05-15	<0.02	ug/L	0
DICAMBA	2018-05-15	<0.20	ug/L	0
DICLOFOP-METHYL	2018-05-15	<0.40	ug/L	0
DIMETHOATE	2018-05-15	<0.03	ug/L	0
DIQUAT	2018-05-15	<1	ug/L	0
DIURON	2018-05-15	<0.03	ug/L	0
GLYPHOSATE	2018-05-15	<1	ug/L	0
MALATHION	2018-05-15	<0.02	ug/L	0
MCPA (2-METHYL-4-CHLOROPHENOXYACETIC ACID)	2018-05-15	<0.00012	mg/L	0
METOLACHLOR	2018-05-15	<0.01	ug/L	0
METRIBUZIN (SENCOR)	2018-05-15	<0.02	ug/L	0

...continued on next page

Summary of Organic parameters required by Regulation 170/03 and tested during this reporting period. (continued)...

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE	NO. OF AWQIs
PARAQUAT	2018-05-15	<1	ug/L	0
POLYCHLORINATED BIPHENYLS (PCB)	2018-05-15	<0.05	ug/L	0
PENTACHLOROPHENOL	2018-05-15	<0.15	ug/L	0
PHORATE	2018-05-15	<0.01	ug/L	0
PICLORAM	2018-05-15	<1	ug/L	0
PROMETRYNE	2018-05-15	<0.03	ug/L	0
SIMAZINE	2018-05-15	<0.01	ug/L	0
TERBUFOS	2018-05-15	<0.01	ug/L	0
TRIALATE	2018-05-15	<0.01	ug/L	0
TRIFLURALIN	2018-05-15	<0.02	ug/L	0

DISTRIBUTION

TOTAL TRIHALOMETHANES*	Running annual average for the last four quarters.	13.0	ug/L	0
HALOACETIC ACIDS	2018-01-22 to 2018-10-16	<5.3	ug/L	N/A

* The Maximum Acceptable Concentration for Trihalomethanes in the distribution is based on a running average of the results from all sampling events in the past four quarters. This running average can be found in the result value column.

List any Inorganic or Organic parameter(s) that exceeded half the standard prescribed in Schedule 2 of Ontario Drinking Water Quality Standards (O.Reg. 169/03).

PARAMETER	SAMPLE DATE	RESULT VALUE	UNIT OF MEASURE
N/A	-	-	-

(Only if DWS category is large municipal residential, small municipal residential, large municipal non residential, non municipal year round residential, large non municipal non residential)

DEFINITIONS:

AWQI: Adverse Water Quality Incident
mg/L: milligrams per litre
ug/L: micrograms per litre

CFU: Colony Forming Unit
mL: millilitre

HPC: Heterotrophic Plate Count
N/A: Not Applicable

